


OPTION 1 - BOX ADJUSTMENT

VALVE BOX/LID - MARKED "WATER",
OLDCASTLE PRECAST NO. G04 BOX, G04C LID

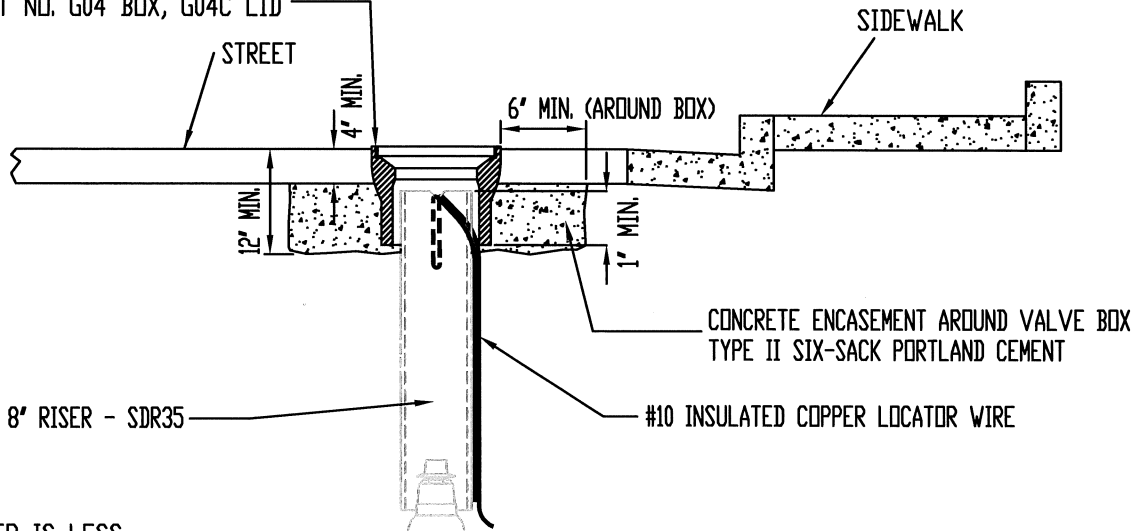

① EXISTING 6' OR 8' RISER - SDR35


#10 INSULATED COPPER LOCATOR WIRE

NOTE:

① IF EXISTING RISER IS LESS THAN 6' IN DIAMETER, A NEW 8' RISER SHALL BE INSTALLED

OPTION 2 - 8" X 8" RISER LENGTHEN

VALVE BOX/LID - MARKED "WATER",
OLDCASTLE PRECAST NO. G04 BOX, G04C LID

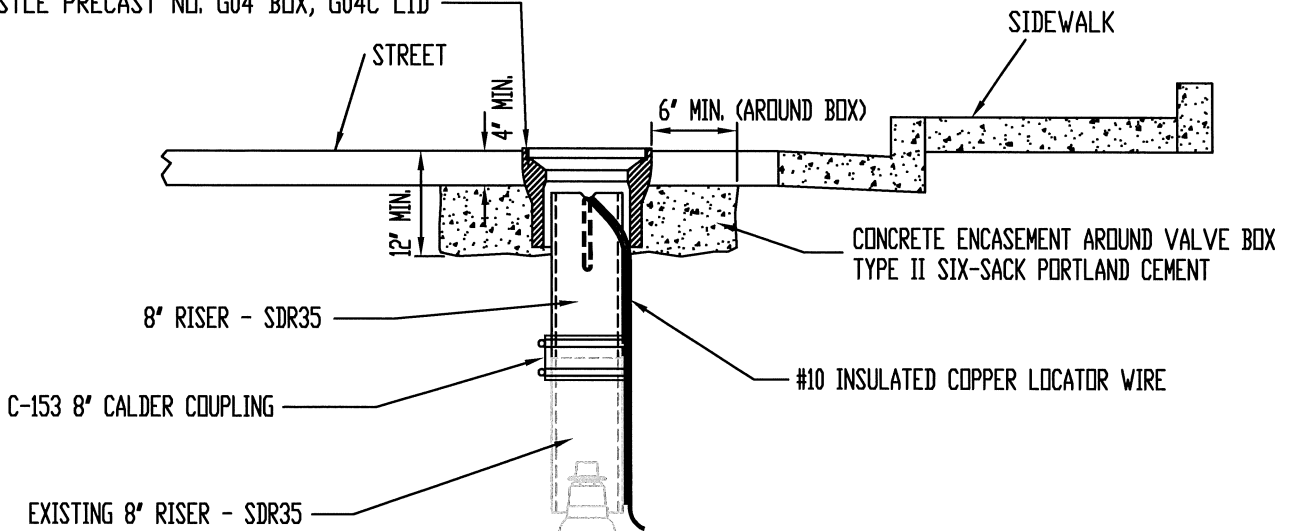

8' RISER - SDR35

CONCRETE ENCASEMENT AROUND VALVE BOX
TYPE II SIX-SACK PORTLAND CEMENT

C-153 8' CALDER COUPLING

#10 INSULATED COPPER LOCATOR WIRE

EXISTING 8' RISER - SDR35



**CITRUS
HEIGHTS
WATER
DISTRICT**

WATER MAIN VALVE BOX - EXTENSION OPTIONS

CITRUS HEIGHTS WATER DISTRICT

APPROVED BY:

Robert A. Ambrose

DATE: 5/8/13

CITRUS HEIGHTS WATER DISTRICT

DRAWN: 8 MAY 2013

REVISED:

SCALE: N.T.S.

DESIGN: P.A.D.


CAD FILE: VB_812_1.DWG

PAGE:

VB_812_1

OPTION 3 - 6" X 8" RISER LENGTHEN

VALVE BOX/LID - MARKED "WATER",
OLDCASTLE PRECAST NO. G04 BOX, G04C LID

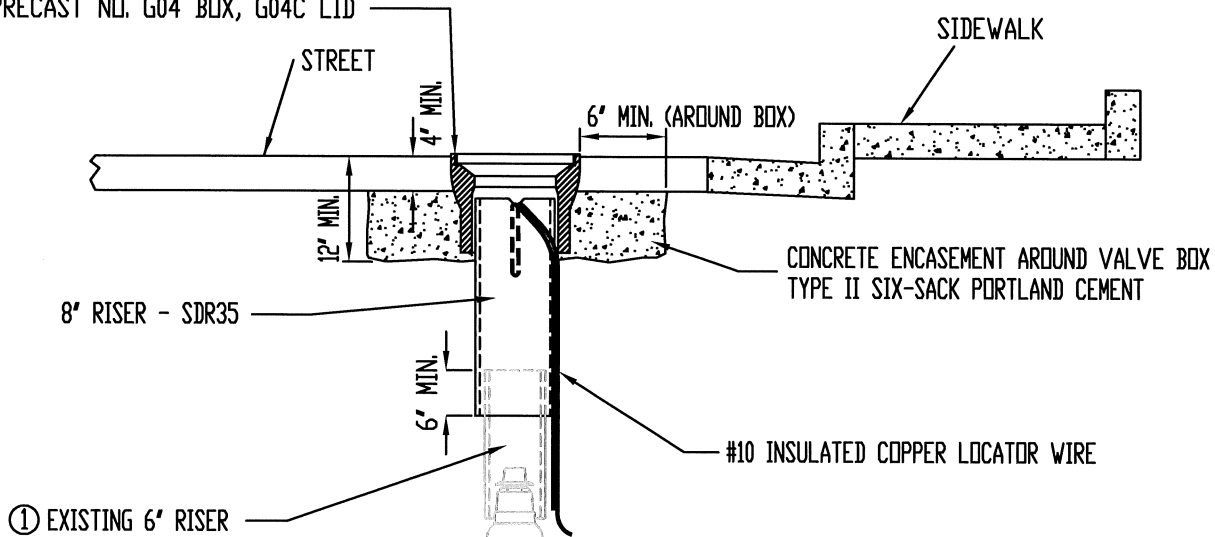

NOTE:

- ① IF EXISTING RISER IS LESS THAN 6' IN DIAMETER, A NEW 8' RISER SHALL BE INSTALLED



**CITRUS
HEIGHTS
WATER
DISTRICT**

WATER MAIN VALVE BOX - EXTENSION OPTIONS

CITRUS HEIGHTS WATER DISTRICT

APPROVED BY:

Robert A. Chamberlain

CITRUS HEIGHTS WATER DISTRICT

DATE: 5/8/13

DRAWN: 8 MAY 2013

REVISED:

SCALE: N.T.S.

DESIGN: P.A.D.

CAD FILE: VB_812_2.DWG

PAGE:

VB_812_2