


OPTION 1 - BOX ADJUSTMENT

VALVE BOX/LID - MARKED "WATER",
OLDCASTLE PRECAST NO. G04 BOX, G04C LID

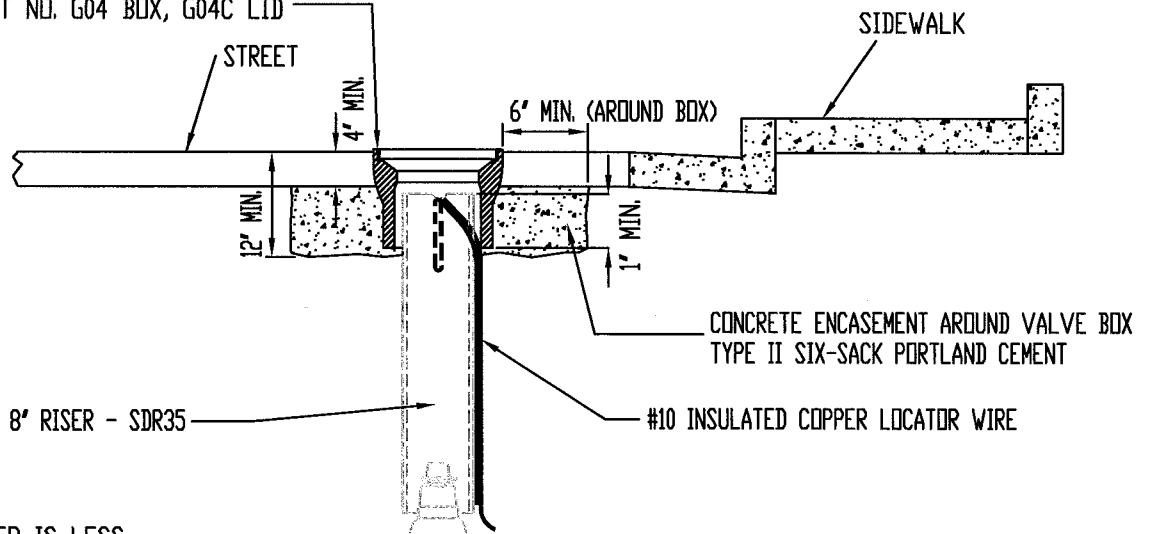


① EXISTING 6" OR 8" RISER - SDR35

NOTE:

① IF EXISTING RISER IS LESS THAN 6" IN DIAMETER, A NEW 8" RISER SHALL BE INSTALLED

OPTION 2 - 8" X 8" RISER LENGTHEN

VALVE BOX/LID - MARKED "WATER",
OLDCASTLE PRECAST NO. G04 BOX, G04C LID

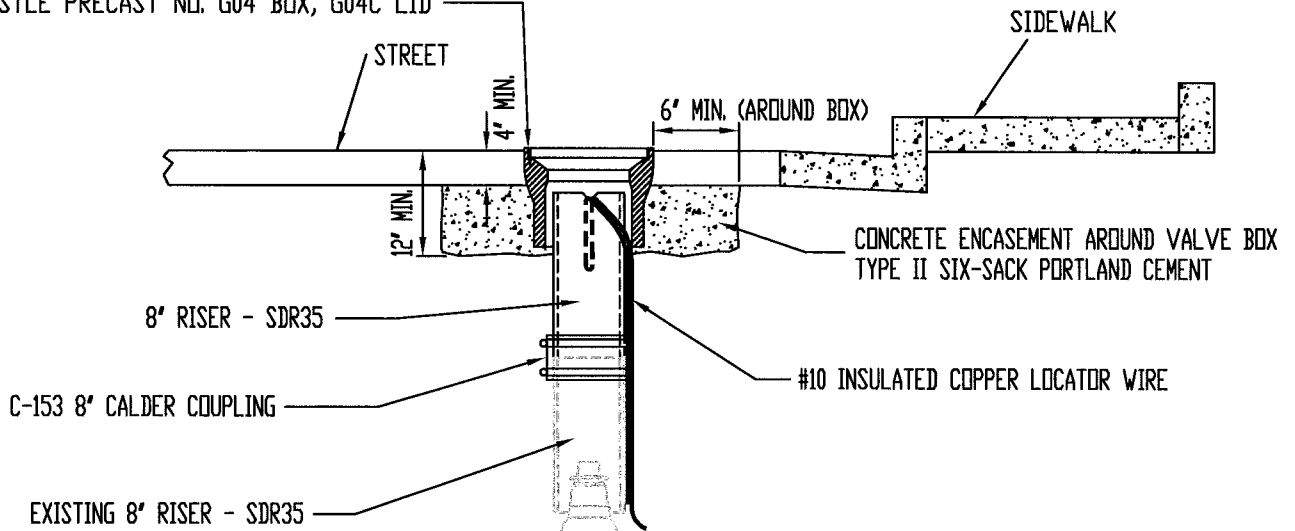

8" RISER - SDR35

C-153 8' CALDER COUPLING

EXISTING 8" RISER - SDR35



**CITRUS
HEIGHTS
WATER
DISTRICT**

WATER MAIN VALVE BOX - EXTENSION OPTIONS

CITRUS HEIGHTS WATER DISTRICT

APPROVED BY:

Robert A. Ambrose

DATE:

5/8/13

CITRUS HEIGHTS WATER DISTRICT

DRAWN: 8 MAY 2013

REVISED:

SCALE: N.T.S.

DESIGN: P.A.D.


CAD FILE: VB_812_1.DWG

PAGE:

VB_812_1

OPTION 3 - 6" X 8" RISER LENGTHEN

VALVE BDX/LID - MARKED "WATER",
 OLDCASTLE PRECAST NO. G04 BDX, G04C LID

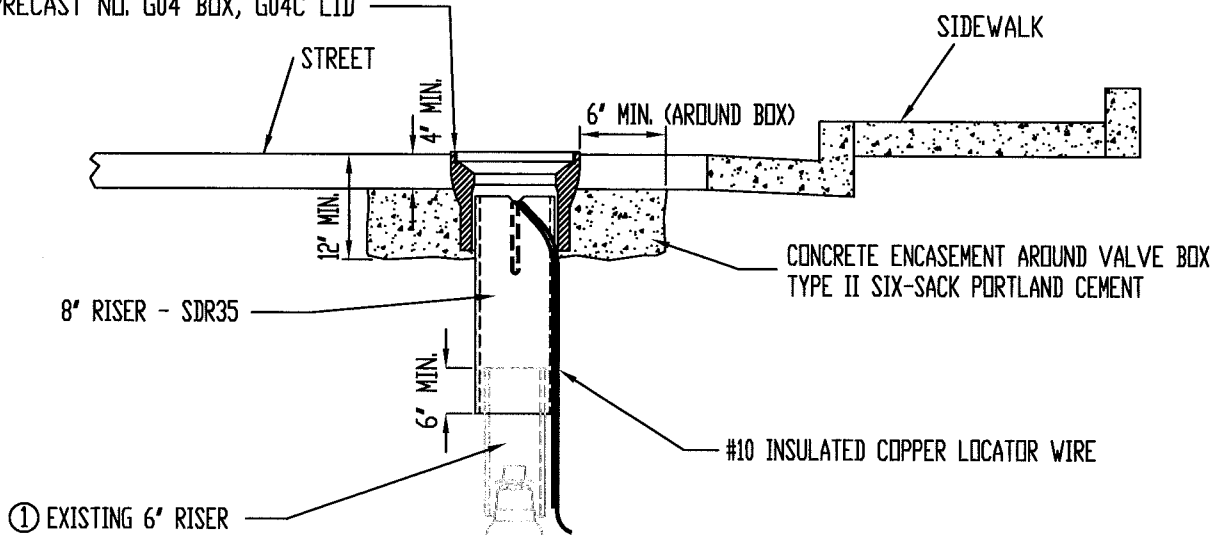

NOTE:

① IF EXISTING RISER IS LESS THAN 6' IN DIAMETER, A NEW 8' RISER SHALL BE INSTALLED



**CITRUS
 HEIGHTS
 WATER
 DISTRICT**

WATER MAIN VALVE BOX - EXTENSION OPTIONS

CITRUS HEIGHTS WATER DISTRICT

APPROVED BY:
Robert A. Chamberlain
 CITRUS HEIGHTS WATER DISTRICT

DATE: 5/8/13

DRAWN: 8 MAY 2013

REVISED:

SCALE: N.T.S.

DESIGN: P.A.D.

CAD FILE: VB_812_2.DWG

PAGE:

VB_812_2